



# SUBMITTAL INFORMATION

**Service Insulator Corporation Stops - (SI-FB600-4-AWT style)**



**AWWA/CC TAPER INLET BY SERVICE INSULATOR BY FLARE COPPER OUTLET**

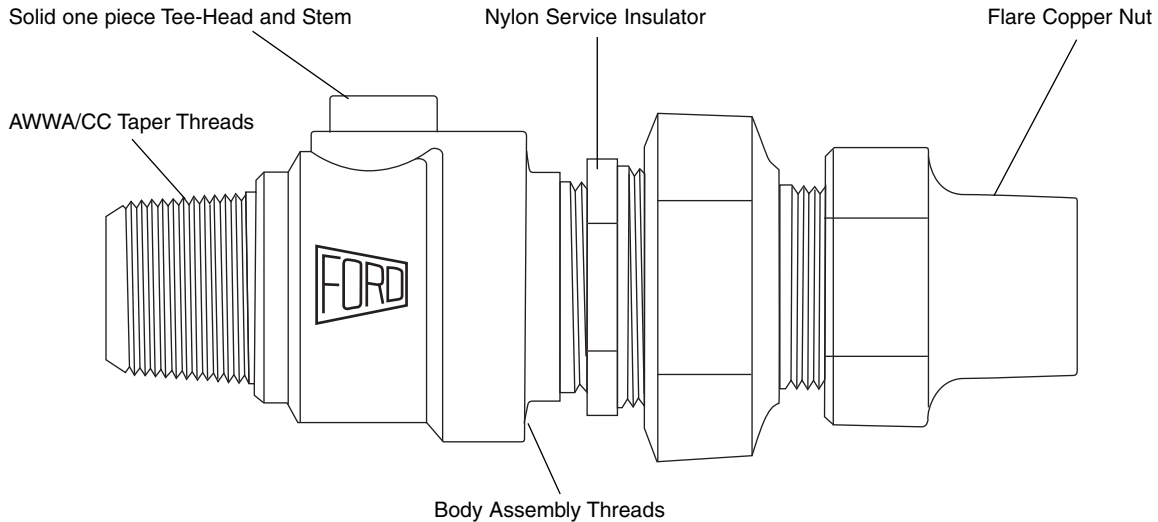

VALVE SIZE	ASSEMBLY INLET SIZE	ASSEMBLY OUTLET SIZE	APPROX. WT. LBS	CATALOG NUMBER	✓ SUBMITTED ITEM(S)
1"	1"	1"	3.8	SI-FB600-4-AWT	

## FEATURES

- All brass conforms to AWWA Standard C800 (ASTM B-62 and ASTM B-584, UNS NO C83600 - 85-5-5-5)
- Corporation Stop body assembly threads are secured with adhesive to prevent unintentional disassembly.
- Solid one piece tee-head and stem with EPDM O-ring in stem.
- Molded EPDM seats support the ball.
- Fluorocarbon-coated brass ball.
- Nylon service insulator provides protection against service line electrolysis.
- 300 PSI working pressure.

The Ford Meter Box Company considers the information in this submittal form to be correct at the time of publication. Item and option availability, including specifications, are subject to change without notice. Please verify that your product information is current.



**The Ford Meter Box Company, Inc.**

P.O. Box 443, Wabash, Indiana U.S.A. 46992-0443  
 Phone: 260-563-3171 / Fax: 800-826-3487  
 Overseas Fax: 260-563-0167  
<http://www.fordmeterbox.com>

01/22/08

Submitted By: