



SUBMITTAL INFORMATION

Pack Joint Coupling - (C07-xx style)



FEMALE COPPER THREAD BY PACK JOINT FOR PVC PIPE

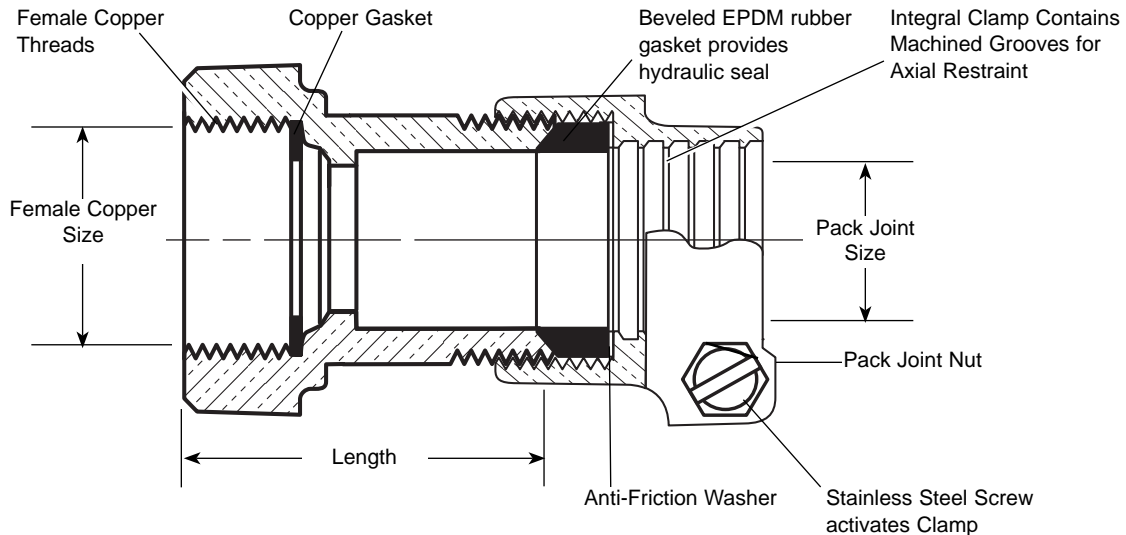

DESCRIPTION		LENGTH	APPROX. Wt. LBS	PART NUMBER	✓ SUBMITTED ITEM(S)
FEMALE COPPER	P.J. FOR PVC				
1/2"	1/2"	1-7/16"	.9	▼ C07-11	
1/2"	3/4"	1-5/16"	.6	▼ C07-13	
3/4"	3/4"	2"	.8	▼ C07-33	
3/4"	1"	2"	1.3	▼ C07-34	
1"	1"	2-1/4"	1.4	▼ C07-44	
1-1/4"	1-1/4"	2-1/16"	1.8	▼▼ C07-55	
1-1/2"	1-1/2"	2-3/4"	2.8	▼▼ C07-66	
2"	2"	2-7/8"	4.6	▼▼ C07-77	

▼ UL Classified to ANSI/NSF Standard 61.

▼▼ Add "-K" to end of catalog number for item to be UL classified to ANSI/NSF Standard 61.

Note: Ford Pack Joints for PVC are only recommended for Schedule 40 and Schedule 80 pipe.



FEATURES

- All brass conforms to AWWA Standard C800 (ASTM B-62 and ASTM B-584 UNS NO C83600 - 85-5-5-5)
- Sleeve design provides hexagonal wrench flats for proper installation.

The Ford Meter Box Company considers the information in this submittal form to be correct at the time of publication. Item and option availability, including specifications, are subject to change without notice. Please verify that your product information is current.



The Ford Meter Box Company, Inc.
 P.O. Box 443, Wabash, Indiana U.S.A. 46992-0443
 Phone: 260-563-3171 / Fax: 800-826-3487
 Overseas Fax: 260-563-0167
<http://www.fordmeterbox.com>

02/18/05

Submitted By: